


Cerner Flash

MM/DD/YYYY

Glucose Tolerance Testing All Facilities

When placing a Glucose Tolerance test, **do not** modify the *Collection Priority* field within the order details. Glucose Tolerance panels must be set as a timed study to properly schedule the collection events to their own containers and draw events.

To properly stagger the collection events for all glucose tests within the plan, only the *Requested Start Date/Time* field is required to be entered prior to signature.

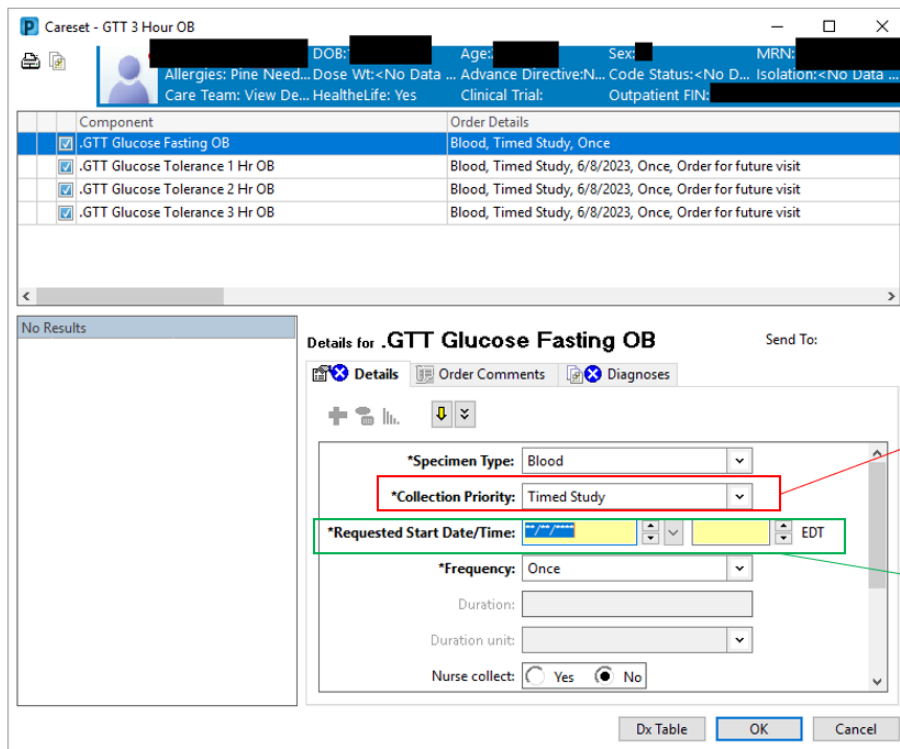

Component	Order Details
<input checked="" type="checkbox"/> .GTT Glucose Fasting OB	Blood, Timed Study, Once
<input checked="" type="checkbox"/> .GTT Glucose Tolerance 1 Hr OB	Blood, Timed Study, 6/8/2023, Once, Order for future visit
<input checked="" type="checkbox"/> .GTT Glucose Tolerance 2 Hr OB	Blood, Timed Study, 6/8/2023, Once, Order for future visit
<input checked="" type="checkbox"/> .GTT Glucose Tolerance 3 Hr OB	Blood, Timed Study, 6/8/2023, Once, Order for future visit

Details for .GTT Glucose Fasting OB

*Specimen Type: Blood

*Collection Priority: Timed Study

*Requested Start Date/Time: [Date/Time] EDT

*Frequency: Once

Duration: [Field]

Duration unit: [Field]

Nurse collect: Yes No

Do Not modify Collection Priority for a GTT panel

Only the Requested Start Date/Time field needs to be set to properly stagger the glucose tests for collection